


1 SITE ELECTRICAL
C505 N.T.S.

- ELECTRICAL GENERAL NOTES**
1. EXISTING ELECTRICAL SERVICE IS 100 AMP 120/208 3 PHASE. SERVICE IS TO BE UPGRADED BY KOPL TO 150 AMP, 120/208 3 PHASE.
 2. CONTRACTOR TO COORDINATE NEW ELECTRIC RISER AND POWER CONNECTION WITH KOPL. REQUIRED DISCONNECTS AND OTHER APPURTENANCES SHALL MEET KOPL REQUIREMENTS AND NEC WHETHER INDICATED ON THE DRAWINGS OR NOT.
 3. CONDUITS SHALL BE SCHED 40 PVC. ALL BENDS SHALL BE LONG SWEEP.
 4. CONDUITS SHALL HAVE 30" MINIMUM BURY DEPTH.
 5. CONDUCTORS NOT SPECIFICALLY IDENTIFIED SHALL BE SIZED TO MEET EQUIPMENT LOADS AND SHALL MEET NEC REQUIREMENTS.

3 AIRLIFT STRUCTURE
C505 N.T.S.

2 NOT USED
C505 N.T.S.

Revisions	No.	Date	Description

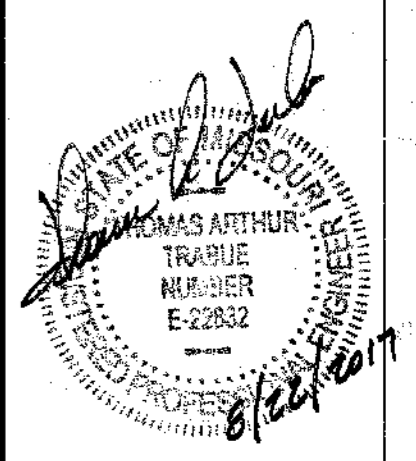

Thomas A. Trabue
MO-E 22832
Expires: 12-31-2018

McCLURE
ENGINEERING CO.
building strong communities.
1901 Pennsylvania Drive
Columbia, MO 65202
P 573-814-1568
F 573-814-1128
MISSOURI CERTIFICATE OF
AUTHORITY NO. E-2006023253
EXPIRES: DECEMBER 31, 2018

City of Sweet Springs
Wastewater Treatment
Improvements
Details

Client Proj # 007380
THinc Proj # 007380
Engineer: TPW
Designer: TPW
Drafter: GRK
Plotted:

DWG. C505
SHT. 15 OF 15