


Missouri State Certificate of Authority #001075  
 PROFESSIONAL SEAL

1736 East Sunshine, Suite 417  
 Springfield, Missouri 65804  
 417-862-0558  
 Fax: 417-862-3265  
 architect@esterlyschneider.com  
 certificate of authority #000718  
 e-mail: architect & planners

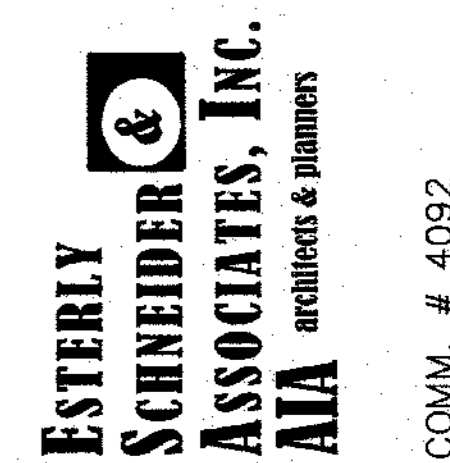

COMM. # 4092

**NOTES:**

- ① NEW AIR HANDLING UNIT. REMOVE AND REPLACE PIPING AND VALVING. REMOVE AND REPLACE 1.5" HWS, 1.5" HWR, 2" CWS AND 2" CWR BRANCH PIPING BACK TO MAIN CONNECTION AND REPLACE ALL DIELECTRIC FITTINGS. PROVIDE NEW SHUT-OFF VALVES AT MAIN PIPING CONNECTION AND RECONNECT TO MAIN PIPING. FIELD VERIFY EXISTING CONDITIONS, AND LOCATION OF CONNECTIONS TO ALL EXISTING PIPING CONNECTIONS PRIOR TO SUBMITTAL OF AIR HANDLING UNIT. PROVIDE ALL REQUIRED ADJUSTMENTS TO EXISTING PIPING TO ACCOMMODATE NEW AIR HANDLING UNIT. PROVIDE 1.25" CONDENSATE DRAIN PIPING AND TERMINATE WITH AIR GAP OVER EXISTING FLOOR DRAIN.
- ② EXISTING HORIZONTAL 4-PIPE FAN COIL UNIT TO REMAIN.
- ③ EXISTING REHEAT COIL TO REMAIN.

**GENERAL NOTES:**

1. FOR ALL MECHANICAL QUESTIONS DURING BIDDING OR DURING CONSTRUCTION, CONTACT SCOTT VANDOREN AT MALONE FINKLE EDWARDS AND COLLINS, INC. (417-881-0020)
2. MECHANICAL HOT WATER HEATING SYSTEM SHALL BE DRAINED DOWN DURING THE COOLING SEASON. BOILER SYSTEM, HOT WATER PUMPS, AND ALL HOT WATER PIPING CHANGES SHALL BE PERFORMED DURING THE COOLING SEASON. ALL WORK SHALL BE PERFORMED, STARTING JUNE 1, 2018 AND SUBSTANTIALLY COMPLETE BY AUGUST 31, 2018.
3. MECHANICAL CHILLED WATER AND CONDENSER WATER SYSTEMS SHALL BE DRAINED DOWN DURING THE HEATING SEASON. CHILLED WATER PUMPS, CONDENSER WATER PUMPS AND ALL CHILLED WATER PIPING CHANGES SHALL BE PERFORMED DURING THE HEATING SEASON. ALL WORK SHALL BE PERFORMED, STARTING DECEMBER 1, 2017 AND SUBSTANTIALLY COMPLETE BY FEBRUARY 28, 2018.
4. CONTRACTOR SHALL COORDINATE WITH THE HVAC WATER TREATMENT CONTRACTOR PER SPECIFICATIONS SECTION 232200. ALL WATER TREATMENT SHALL BE COMPLETED BY THE SYSTEM SUBSTANTIAL COMPLETION DATE.
5. TEST, ADJUST AND BALANCE REPORT FOR THE WATER SYSTEMS SHALL BE COMPLETE AND APPROVED BY THE ENGINEER PRIOR TO THE SUBSTANTIAL COMPLETION DATE OF EACH WATER SYSTEM.

